

Submittal Sheets

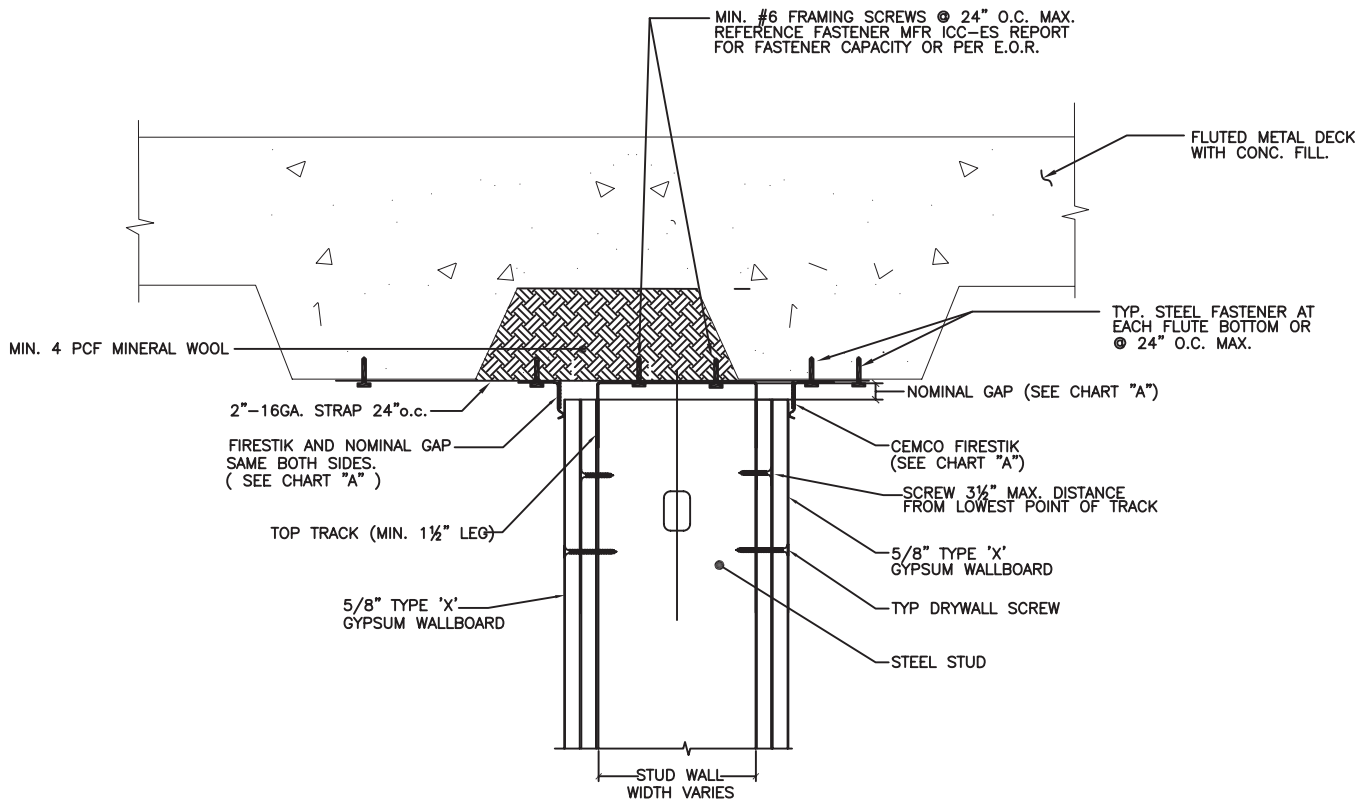


CHART "A"

FIRESTICK PROFILE	NOMINAL GAP	+/- VERT. MOVEMENT	TOTAL DEFLECTION
FS1	1/2"	1/2"	1"
FS2	1"	1"	2"

NOTES:

1. Cyclical Design - UL 2079 Test Standard.
2. Do not screw drywall or stud to track.
3. Track Leg min. ½" longer than total deflection.
4. Consult manufacturer on track movement capabilities.
5. Reference ITS / Warnock Hersey directory for specific information.
6. Reference UL Fire Resistance Directory for specific information.



HEAD OF WALL SYSTEM 1, PARALLEL AND CANTILEVERED TO MINERAL WOOL FILLED FLUTE. 1 AND 2 HOUR FIRE RESISTANT ASSEMBLY. (SEE UL LISTING FOR WALL FIRE RATING).
UL-2079 TEST STD.